
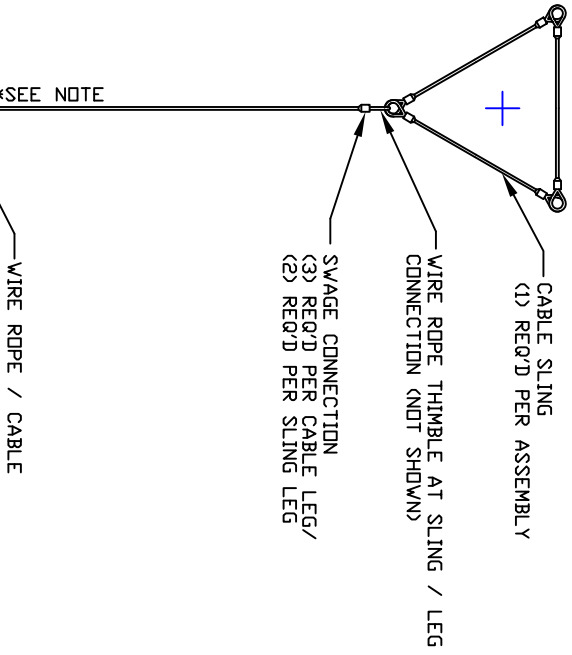
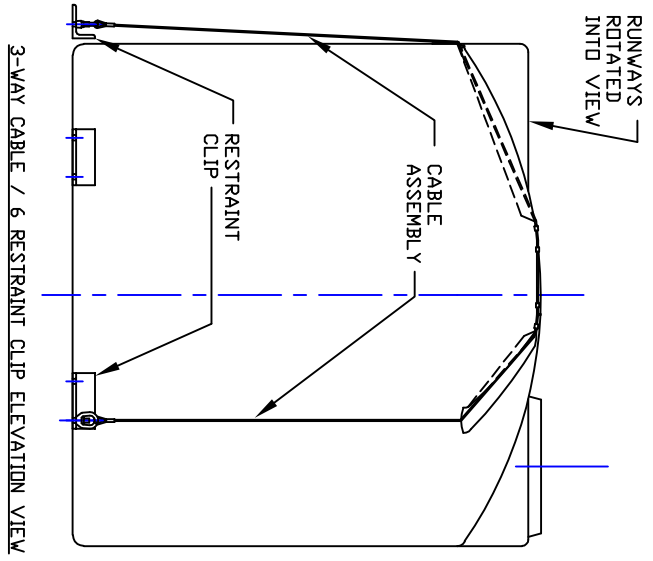


NON-CONTROLLED COPY
 INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE
 COPY WILL NOT BE UPDATED

COPY ISSUED BY _____
 COPY ISSUED ON _____

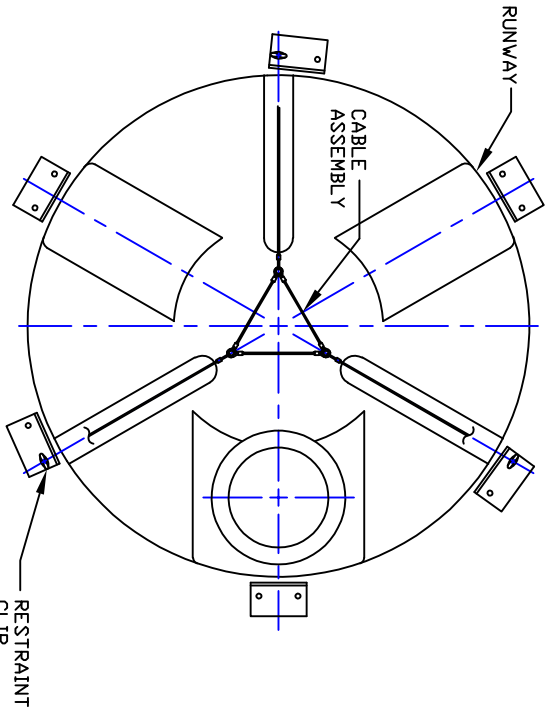

*NOTE: AS REQ'D PER INDIVIDUAL SYSTEM DESIGN

CABLE ASSEMBLY (ONE LEG SHOWN)

RESTRAINT CLIP, CABLE, WIRE ROPE THIMBLE AND (2) WIRE ROPE CLIPS.

1" CLEARANCE REQ'D BETWEEN BACK OF CLIP AND TANK WALL

WIRE ROPE THIMBLE

TAPPED EYE NUT ATTACHED TO ANCHOR BOLT

RESTRAINT CLIP

RESTRAINT CLIP / CABLE CONNECTION

- NOTES:
1. THIS IS A COMPUTER GENERATED DRAWING. DO NOT REVISE BY HAND.
 2. SIZE AND QUANTITY OF RESTRAINT CLIPS, CABLE LEGS AND OTHER COMPONENTS MAY VARY ACCORDING TO TANK SIZE AND RESTRAINT SYSTEM RATING.
 3. RESTRAINT SYSTEM MAY CONSIST OF RESTRAINT CLIPS ONLY.
 4. ANCHOR BOLTS TO BE SUPPLIED BY OTHERS.
 5. ANCHOR BOLT LENGTH, EMBEDMENT AND METHOD OF ANCHORAGE TO BE DETERMINED BY A FOUNDATION ENGINEER UPON INSPECTION OF THE INSTALLATION SITE AND REVIEW OF THE APPLICABLE LOADS.

DVG TITLE		RESTRAINT SYSTEM/GALVANIZED FOR VERTICAL TANKS	
SCALE:	1/2"=1'-0"	DR:	B. HARPER
DATE:	5/20/2020	CK:	
		Central Region P.O. Box 4500, Chester PA 15312-4500 717.345.2600 FAX: 717.345.9795	
SHEET	1 OF 1	COMPUTER FILE	2018RESTGLVSSYM
REV			