




SCALE: 1"=1'-0"




1 REQUIRED AS SHOWN SCALE: 1"=1'-0"

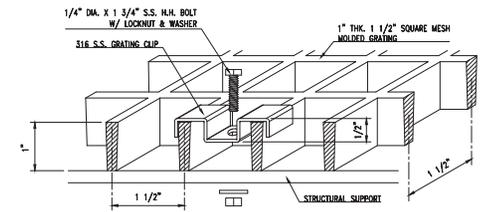

SCALE: N.T.S.

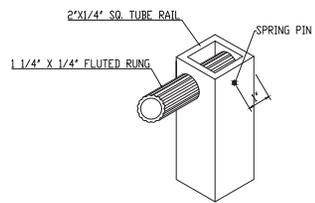

SCALE: N.T.S.

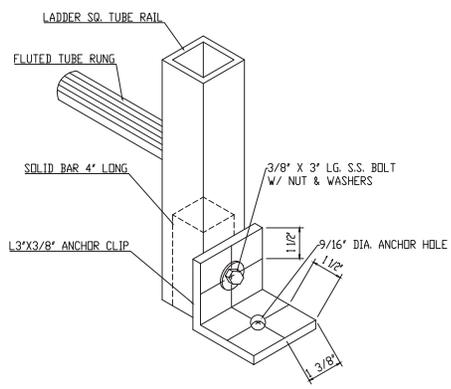

SCALE: N.T.S.

**Select Ladder**

	X Dim	Y Dim
<input type="checkbox"/>	5'	8' 6"
<input type="checkbox"/>	6'	9' 6"
<input type="checkbox"/>	7'	10' 6"
<input type="checkbox"/>	8'	11' 6"
<input type="checkbox"/>	9'	12' 6"
<input type="checkbox"/>	10'	13' 6"
<input type="checkbox"/>	11'	14' 6"
<input type="checkbox"/>	12'	15' 6"
<input type="checkbox"/>	13'	16' 6"
<input type="checkbox"/>	14'	17' 6"
<input type="checkbox"/>	15'	18' 6"
<input type="checkbox"/>	16'	19' 6"
<input type="checkbox"/>	17'	20' 6"
<input type="checkbox"/>	18'	21' 6"

- FRP LADDER:**
- 1). FABRICATED IN ACCORDANCE WITH OSHA REQUIREMENTS #1910.27
  - 2). SIDE RAILS ARE TO BE 2" X 1/4" FRP SQUARE TUBING.
  - 3). RUNGS ARE TO BE 1 1/4" DIA. X 1/4" ROUND FLUTED TUBE.
  - 4). RUNGS ARE TO BE ATTACHED TO SQUARE TUBING WITH DOWEL AND GLUE METHOD, PREVENTING RUNG ROTATION.
  - 5). STAND-OFF CLIPS ARE SPACED @ 6'-0" MAXIMUM AND TO BE FRP.
  - 6). RESIN SYSTEMS TO BE VINYLESTER.
  - 7). STAND-OFF CLIPS TO BE FIELD LOCATED AND INSTALLED.
  - 8). STAND-OFF & BASE CLIPS TO BE VINYLESTER BEGE.
  - 9). FRP MATERIALS MEETS ASTM E-84, CLASS 1, FLAME SPREAD RATING LESS THAN 25 AND SELF EXTINGUISHING REQUIREMENTS OF ASTM D-635.

**POLYPROCESSING**  
 CENTRAL REGION  
 P.O. BOX 4185 (71211)  
 2201 OLD STERLINGTON RD.  
 MONROE, LA 71203  
 PH: 318-343-7555  
 FAX: 318-343-8785

SCALE: 1" = 1'-0" DATE: 12-18-13 APPROVED BY: CHECKED BY: DRAWN BY: RLB  
 TITLE: LADDER  
 LADDER NO.: LOCATION: MONROE, LOUISIANA ANALYSIS NO.: